TEST STATISTICS REPORT

California-Nevada Distribution Grade I Exam

DCN0811S

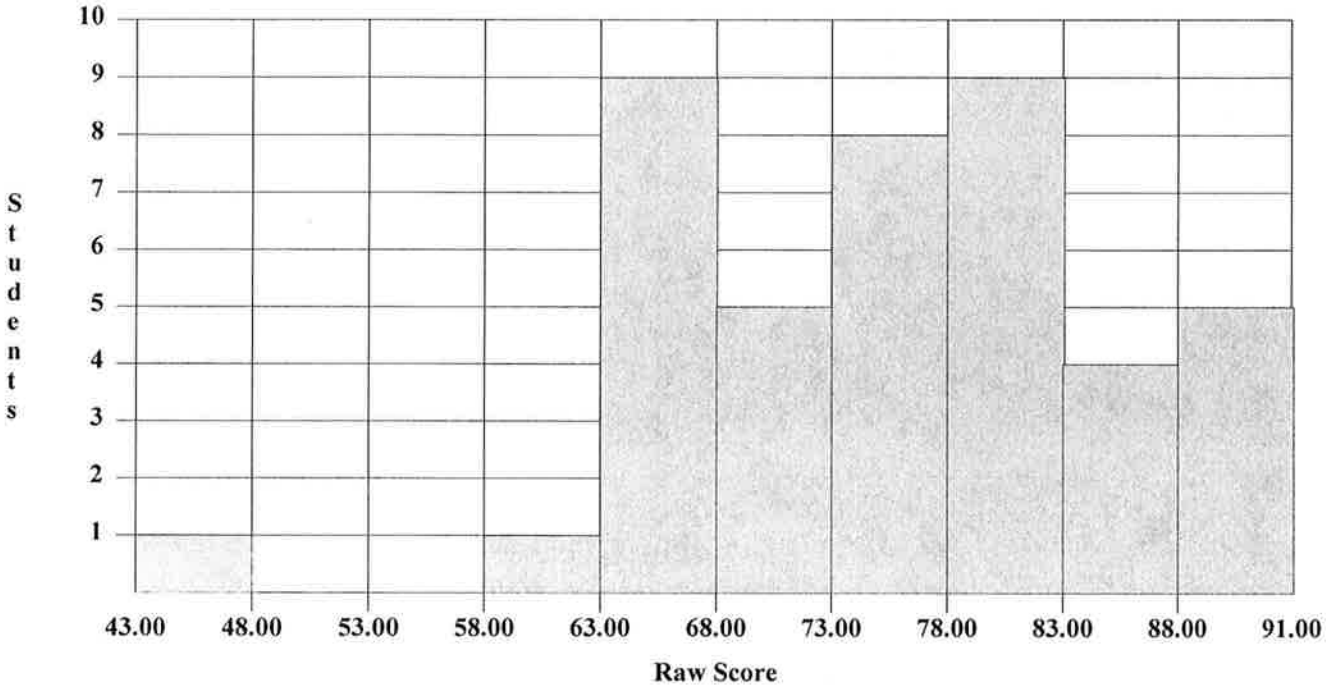

Test Name:	**DCE0811S**	
Test Date:	**11/4/2007**	
Number of Examinees:	**42**	
Number of Items:	**100**	
Maximum Possible Points:	**100.00**	
Highest Score:	**91.00**	**(91.00)**
Lowest Score:	**43.00**	**(43.00)**
Median:	**75.50**	**(75.50)**
Mean:	**74.95**	**(74.95)**
Standard Deviation:	**10.06**	
Test Reliability:	**0.85**	
Standard Error of Measurement:	**3.84**	

MASTERY SUMMARY REPORT

for California-Nevada Distribution Grade I Exam

Test Name: DCN0811S

Test version: 0

Scoring Date: Friday, March 25, 2011

# of Students: 42

# M	**Number Mastering**	**% M**	**% Mastering**	**PTS**	**Possible Points**
# PM	**Number Partial Mastering**	**% PM**	**% Partial Mastering**	**HIGH**	**Highest Points**
# NM	**Number Not Mastering**	**% NM**	**% Not Mastering**	**LOW**	**Lowest Points**
				AVG	**Average Points**

Objective	# M	# PM	# NM	% M	% PM	% NM	PTS	HIGH	LOW	AVG
Perform Administrative Duties	31	8	3	73.81	19.05	7.14	4.00	4.00	1.00	3.00
Perform Administrative Duties-Math	41	0	1	97.62	0.00	2.38	1.00	1.00	0.00	0.98
Drinking Water Regulations	31	9	2	73.81	21.43	4.76	10.00	10.00	3.00	7.21
Evaluate Equipment-Math	35	0	7	83.33	0.00	16.67	1.00	1.00	0.00	0.83
Install Equipment-Math	21	15	6	50.00	35.71	14.29	2.00	2.00	0.00	1.36
Install Equipment	24	15	3	57.14	35.71	7.14	9.00	9.00	2.00	6.50
Maintain Equipment-Math	20	14	8	47.62	33.33	19.05	2.00	2.00	0.00	1.29
Maintain Equipment	26	14	2	61.90	33.33	4.76	11.00	11.00	4.00	7.81
Disinfection	24	12	6	57.14	28.57	14.29	4.00	4.00	1.00	2.62
Disinfection-Math	20	0	22	47.62	0.00	52.38	1.00	1.00	0.00	0.48
Operate Equipment-Math	31	10	1	73.81	23.81	2.38	2.00	2.00	0.00	1.71
Operate Equipment	33	8	1	78.57	19.05	2.38	13.00	13.00	5.00	10.43
Perform Security & Safety Procedures	36	5	1	85.71	11.90	2.38	8.00	8.00	3.00	6.55
Perform Security Procedures	8	16	18	19.05	38.10	42.86	2.00	2.00	0.00	0.76
System Design	32	10	0	76.19	23.81	0.00	9.00	9.00	5.00	7.36
System Design-Math	40	0	2	95.24	0.00	4.76	1.00	1.00	0.00	0.95
System Inspection	21	20	1	50.00	47.62	2.38	5.00	5.00	1.00	3.50
Water Quality	32	10	0	76.19	23.81	0.00	15.00	15.00	6.00	11.62

TEST STATISTICS REPORT

California-Nevada Distribution Grade II Exam

DCN0821S

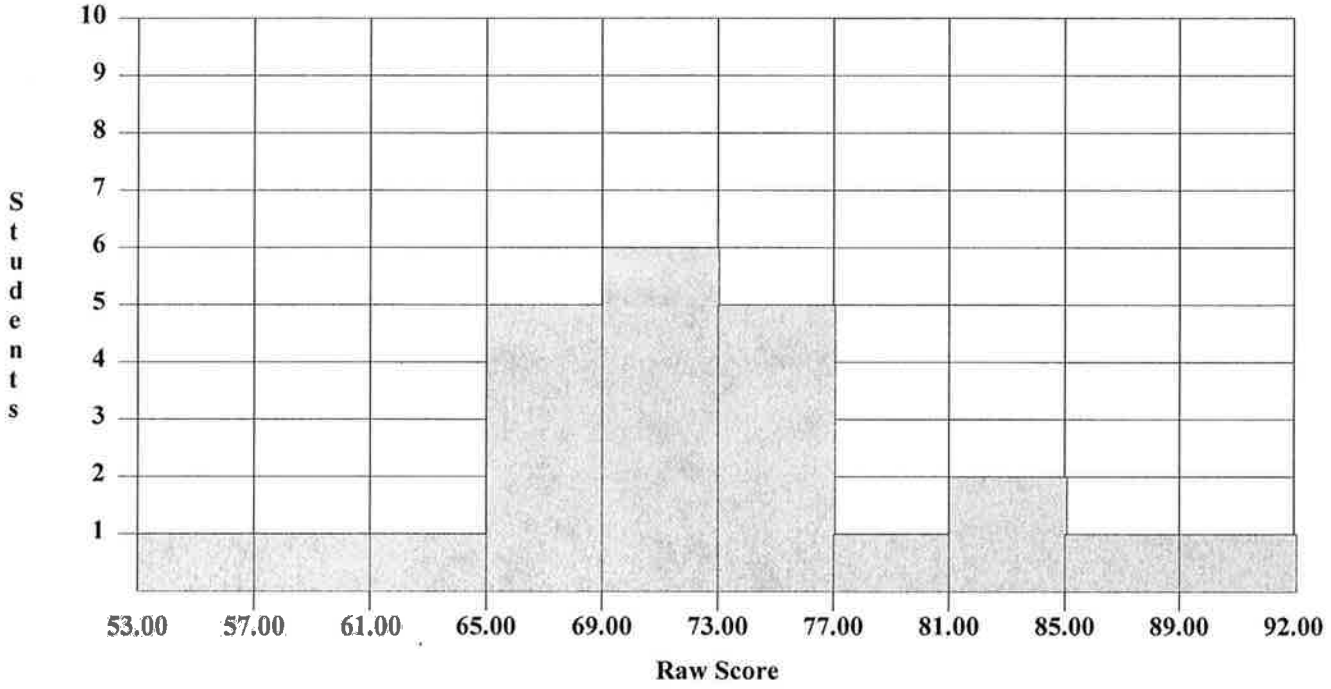

Test Name:	**DCE0821S**	
Test Date:	**11/1/2007**	
Number of Examinees:	**24**	
Number of Items:	**100**	
Maximum Possible Points:	**100.00**	
Highest Score:	**92.00**	**(92.00)**
Lowest Score:	**53.00**	**(53.00)**
Median:	**71.50**	**(71.50)**
Mean:	**72.04**	**(72.04)**
Standard Deviation:	**8.84**	
Test Reliability:	**0.80**	
Standard Error of Measurement:	**3.92**	

MASTERY SUMMARY REPORT

for California-Nevada Distribution Grade II Exam

Test Name: DCN0821S

Test version: 0

Scoring Date: Friday, March 25, 2011

# of Students: 24

# M	**Number Mastering**	**% M**	**% Mastering**	**PTS**	**Possible Points**
# PM	**Number Partial Mastering**	**% PM**	**% Partial Mastering**	**HIGH**	**Highest Points**
# NM	**Number Not Mastering**	**% NM**	**% Not Mastering**	**LOW**	**Lowest Points**
				AVG	**Average Points**

Objective	# M	# PM	# NM	% M	% PM	% NM	PTS	HIGH	LOW	AVG
Perform Administrative Duties	8	9	7	33.33	37.50	29.17	4.00	4.00	0.00	1.96
Perform Administrative Duties-Math	13	0	11	54.17	0.00	45.83	1.00	1.00	0.00	0.54
Drinking Water Regulations	16	8	0	66.67	33.33	0.00	10.00	10.00	4.00	7.08
Evaluate Equipment-Math	19	0	5	79.17	0.00	20.83	1.00	1.00	0.00	0.79
Evaluate Operation of Equipment	6	11	7	25.00	45.83	29.17	3.00	3.00	0.00	1.83
Install Equipment	19	5	0	79.17	20.83	0.00	9.00	9.00	6.00	7.50
Maintain Equipment-Math	15	0	9	62.50	0.00	37.50	1.00	1.00	0.00	0.63
Maintain Equipment	21	3	0	87.50	12.50	0.00	7.00	7.00	4.00	5.33
Disinfection	10	14	0	41.67	58.33	0.00	5.00	5.00	2.00	3.38
Operate Equipment-Math	14	9	1	58.33	37.50	4.17	2.00	2.00	0.00	1.54
Operate Equipment	19	5	0	79.17	20.83	0.00	14.00	14.00	6.00	10.71
Perform Security & Safety Procedures	10	12	2	41.67	50.00	8.33	6.00	6.00	2.00	4.08
Perform Security Procedures	16	8	0	66.67	33.33	0.00	4.00	4.00	2.00	2.92
System Design	10	13	1	41.67	54.17	4.17	6.00	6.00	2.00	4.33
System Design-Math	16	6	2	66.67	25.00	8.33	7.00	7.00	2.00	4.92
System Inspection	17	6	1	70.83	25.00	4.17	4.00	4.00	1.00	3.08
System Inspection-Math	17	0	7	70.83	0.00	29.17	1.00	1.00	0.00	0.71
Water Quality	13	11	0	54.17	45.83	0.00	15.00	15.00	7.00	10.71

TEST STATISTICS REPORT

California-Nevada Distribution Grade III Exam

DCN0831S

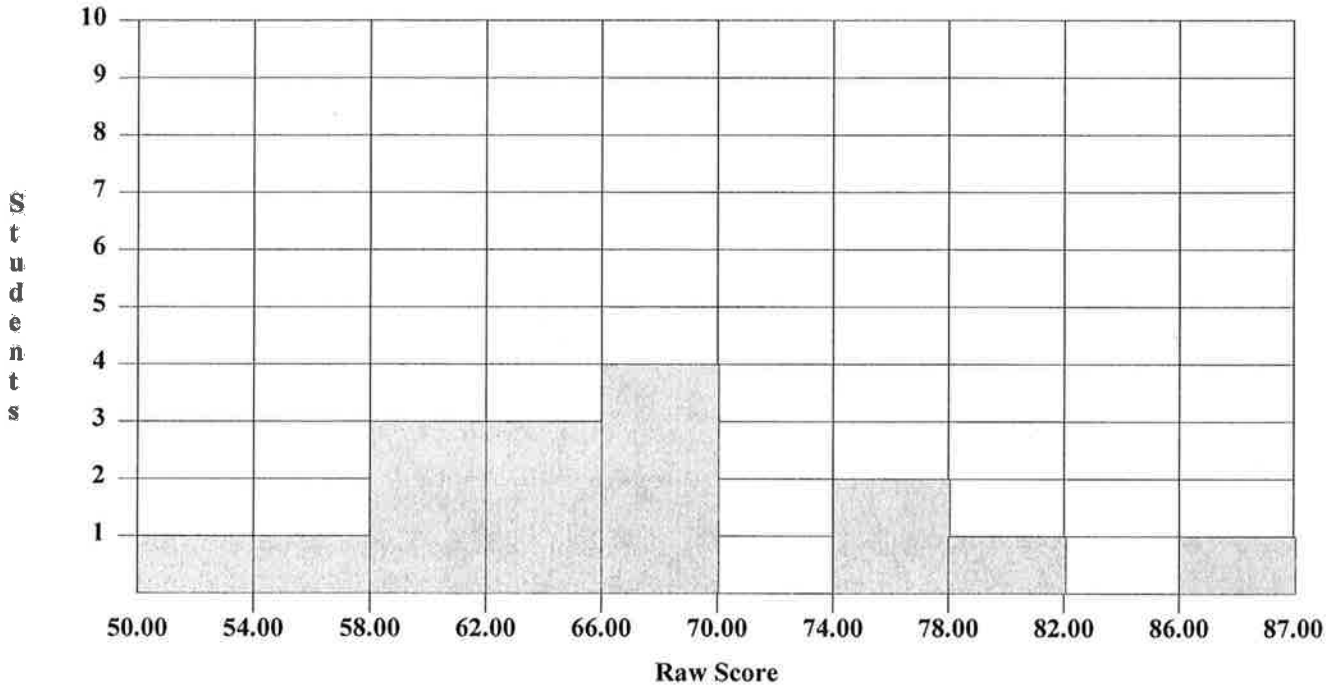

Test Name:	**DCE0831S**	
Test Date:	**10/17/2007**	
Number of Examinees:	**16**	
Number of Items:	**100**	
Maximum Possible Points:	**100.00**	
Highest Score:	**87.00**	**(87.00)**
Lowest Score:	**50.00**	**(50.00)**
Median:	**65.00**	**(65.00)**
Mean:	**66.44**	**(66.44)**
Standard Deviation:	**9.23**	
Test Reliability:	**0.80**	
Standard Error of Measurement:	**4.08**	

MASTERY SUMMARY REPORT

for California-Nevada Distribution Grade III Exam

Test Name: DCN0831S

Test version: 0

Scoring Date: Friday, March 25, 2011

# of Students: 16

# M	**Number Mastering**	**% M**	**% Mastering**	**PTS**	**Possible Points**
# PM	**Number Partial Mastering**	**% PM**	**% Partial Mastering**	**HIGH**	**Highest Points**
# NM	**Number Not Mastering**	**% NM**	**% Not Mastering**	**LOW**	**Lowest Points**
				AVG	**Average Points**

Objective	# M	# PM	# NM	% M	% PM	% NM	PTS	HIGH	LOW	AVG
Perform Administrative Duties	14	2	0	87.50	12.50	0.00	5.00	5.00	3.00	4.00
Perform Administrative Duties-Math	6	9	1	37.50	56.25	6.25	5.00	5.00	1.00	3.06
Drinking Water Regulations	4	12	0	25.00	75.00	0.00	10.00	7.00	4.00	5.25
Evaluate Equipment-Math	11	0	5	68.75	0.00	31.25	1.00	1.00	0.00	0.69
Install Equipment-Math	13	0	3	81.25	0.00	18.75	1.00	1.00	0.00	0.81
Install Equipment	11	3	2	68.75	18.75	12.50	8.00	8.00	3.00	5.88
Maintain Equipment-Math	14	0	2	87.50	0.00	12.50	1.00	1.00	0.00	0.88
Maintain Equipment	5	11	0	31.25	68.75	0.00	5.00	5.00	2.00	3.06
Disinfection	1	7	8	6.25	43.75	50.00	3.00	3.00	0.00	1.31
Disinfection-Math	7	6	3	43.75	37.50	18.75	2.00	2.00	0.00	1.25
Operate Equipment-Math	4	10	2	25.00	62.50	12.50	2.00	2.00	0.00	1.13
Operate Equipment	10	4	2	62.50	25.00	12.50	14.00	14.00	4.00	9.44
Perform Security & Safety Procedures	13	3	0	81.25	18.75	0.00	8.00	8.00	5.00	6.25
Perform Security Procedures	3	9	4	18.75	56.25	25.00	2.00	2.00	0.00	0.94
System Design	14	2	0	87.50	12.50	0.00	9.00	9.00	5.00	7.44
System Design-Math	3	3	10	18.75	18.75	62.50	4.00	4.00	0.00	1.31
System Inspection	10	5	1	62.50	31.25	6.25	4.00	4.00	1.00	2.75
System Inspection-Math	9	0	7	56.25	0.00	43.75	1.00	1.00	0.00	0.56
Water Quality-Math	8	0	8	50.00	0.00	50.00	1.00	1.00	0.00	0.50
Water Quality	9	7	0	56.25	43.75	0.00	14.00	13.00	7.00	9.94

TEST STATISTICS REPORT

California-Nevada Distribution Grade IV Exam

DCN5941S

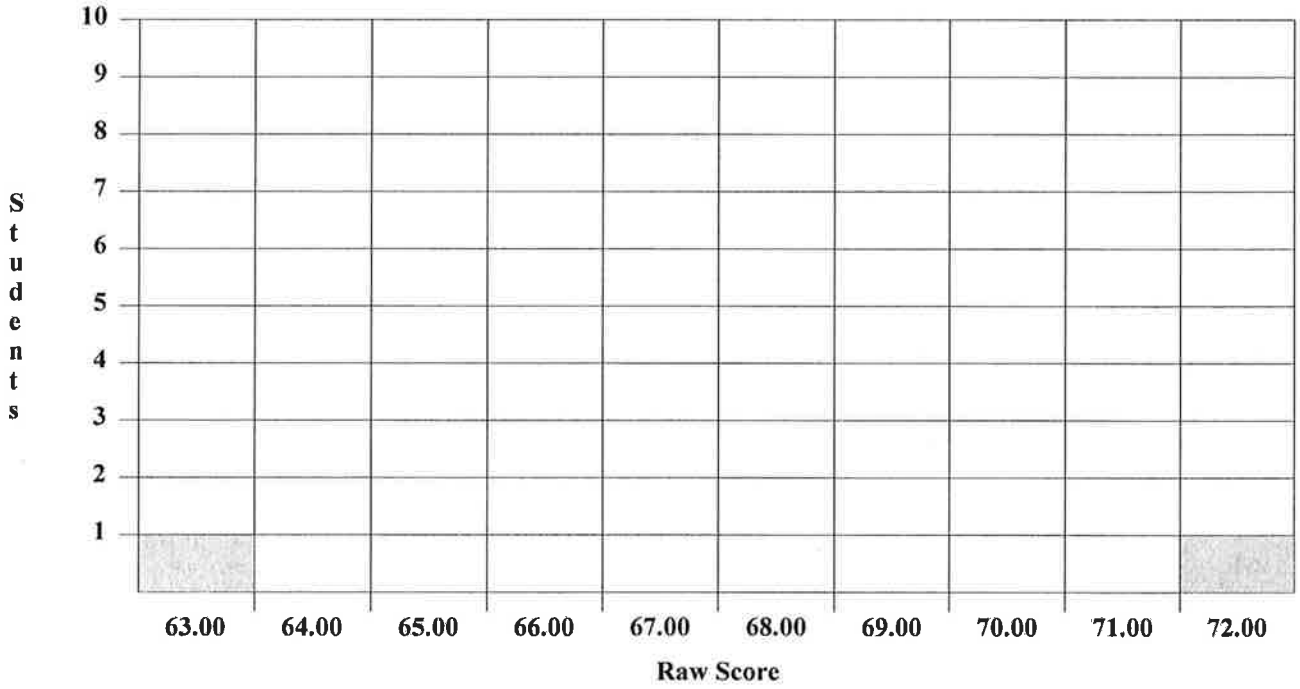

Test Name:	**DCE0841S**	
Test Date:	**10/17/2007**	
Number of Examinees:	**2**	
Number of Items:	**100**	
Maximum Possible Points:	**100.00**	
Highest Score:	**72.00**	**(72.00)**
Lowest Score:	**63.00**	**(63.00)**
Median:	**67.50**	**(67.50)**
Mean:	**67.50**	**(67.50)**
Standard Deviation:	**6.36**	
Test Reliability:	**0.60**	
Standard Error of Measurement:	**4.03**	

MASTERY SUMMARY REPORT
for California-Nevada Distribution Grade IV Exam

Test Name: DCN5941S
Scoring Date: Friday, March 25, 2011

Test version: 0
# of Students: 2

# M	**Number Mastering**	**% M**	**% Mastering**	**PTS**	**Possible Points**
# PM	**Number Partial Mastering**	**% PM**	**% Partial Mastering**	**HIGH**	**Highest Points**
# NM	**Number Not Mastering**	**% NM**	**% Not Mastering**	**LOW**	**Lowest Points**
				AVG	**Average Points**

Objective	# M	# PM	# NM	% M	% PM	% NM	PTS	HIGH	LOW	AVG
Perform Administrative Duties	1	1	0	50.00	50.00	0.00	7.00	5.00	4.00	4.50
Perform Administrative Duties-Math	1	0	1	50.00	0.00	50.00	1.00	1.00	0.00	0.50
Drinking Water Regulations	0	2	0	0.00	100.00	0.00	10.00	6.00	5.00	5.50
Install Equipment-Math	2	0	0	100.00	0.00	0.00	1.00	1.00	1.00	1.00
Install Equipment	2	0	0	100.00	0.00	0.00	8.00	6.00	6.00	6.00
Maintain Equipment-Math	0	0	2	0.00	0.00	100.00	3.00	1.00	1.00	1.00
Maintain Equipment	0	1	1	0.00	50.00	50.00	2.00	1.00	0.00	0.50
Disinfection	2	0	0	100.00	0.00	0.00	4.00	3.00	3.00	3.00
Disinfection-Math	0	0	2	0.00	0.00	100.00	1.00	0.00	0.00	0.00
Operate Equipment-Math	0	1	1	0.00	50.00	50.00	3.00	2.00	1.00	1.50
Operate Equipment	1	1	0	50.00	50.00	0.00	13.00	10.00	9.00	9.50
Perform Security & Safety Procedures	2	0	0	100.00	0.00	0.00	7.00	7.00	7.00	7.00
Perform Security Procedures	2	0	0	100.00	0.00	0.00	5.00	5.00	5.00	5.00
System Design	1	1	0	50.00	50.00	0.00	8.00	7.00	4.00	5.50
System Design-Math	1	1	0	50.00	50.00	0.00	7.00	6.00	4.00	5.00
System Inspection	1	1	0	50.00	50.00	0.00	5.00	4.00	2.00	3.00
Water Quality	0	2	0	0.00	100.00	0.00	15.00	10.00	8.00	9.00

TEST STATISTICS REPORT

California-Nevada Water Treatment Grade I Exam

WCN2811S

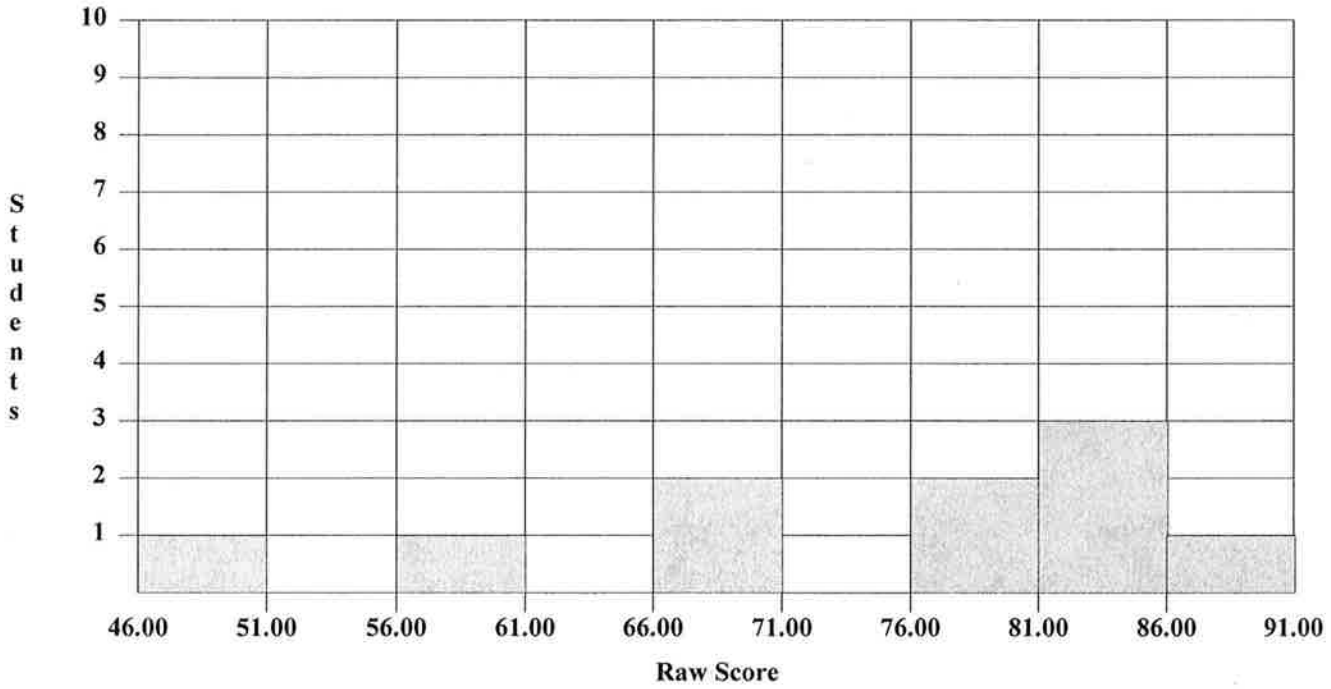

Test Name:	**WCE2811S**	
Test Date:	**2/21/2008**	
Number of Examinees:	**10**	
Number of Items:	**100**	
Maximum Possible Points:	**100.00**	
Highest Score:	**86.00**	**(86.00)**
Lowest Score:	**46.00**	**(46.00)**
Median:	**79.50**	**(79.50)**
Mean:	**73.50**	**(73.50)**
Standard Deviation:	**13.01**	
Test Reliability:	**0.91**	
Standard Error of Measurement:	**3.86**	

MASTERY SUMMARY REPORT
for California-Nevada Water Treatment Grade I Exam

Test Name: WCN2811S
Scoring Date: Friday, March 25, 2011

Test version: 0
# of Students: 10

# M	**Number Mastering**	**% M**	**% Mastering**	**PTS**	**Possible Points**
# PM	**Number Partial Mastering**	**% PM**	**% Partial Mastering**	**HIGH**	**Highest Points**
# NM	**Number Not Mastering**	**% NM**	**% Not Mastering**	**LOW**	**Lowest Points**
				AVG	**Average Points**

Objective	# M	# PM	# NM	% M	% PM	% NM	PTS	HIGH	LOW	AVG
Perform Administrative Duties	10	0	0	100.00	0.00	0.00	3.00	3.00	3.00	3.00
Collect Samples & Interpret Analysis	9	1	0	90.00	10.00	0.00	11.00	11.00	5.00	9.00
Drinking Water Regulations	5	5	0	50.00	50.00	0.00	20.00	17.00	8.00	13.10
Evaluate Equipment-Math	9	1	0	90.00	10.00	0.00	2.00	2.00	1.00	1.90
Evaluate Operation of Equipment	9	0	1	90.00	0.00	10.00	2.00	2.00	0.00	1.80
Characteristics of Source Water	6	4	0	60.00	40.00	0.00	5.00	5.00	2.00	4.00
Process Control Laboratory Analysis	4	5	1	40.00	50.00	10.00	5.00	5.00	1.00	3.30
Maintain Equipment	6	3	1	60.00	30.00	10.00	13.00	12.00	5.00	9.60
Chemical Treatment/Addition-Math	3	3	4	30.00	30.00	40.00	6.00	6.00	0.00	3.40
Chemical Treatment/Addition	6	2	2	60.00	20.00	20.00	13.00	13.00	4.00	9.00
Residuals Disposal	6	0	4	60.00	0.00	40.00	1.00	1.00	0.00	0.60
General Math	7	3	0	70.00	30.00	0.00	4.00	4.00	2.00	3.00
Operate Equipment	6	4	0	60.00	40.00	0.00	7.00	7.00	3.00	4.80
Perform Security & Safety Procedures	10	0	0	100.00	0.00	0.00	7.00	7.00	5.00	6.10
Perform Security Procedures	9	0	1	90.00	0.00	10.00	1.00	1.00	0.00	0.90

TEST STATISTICS REPORT

California-Nevada Water Treatment Grade II Exam

WCN0821S

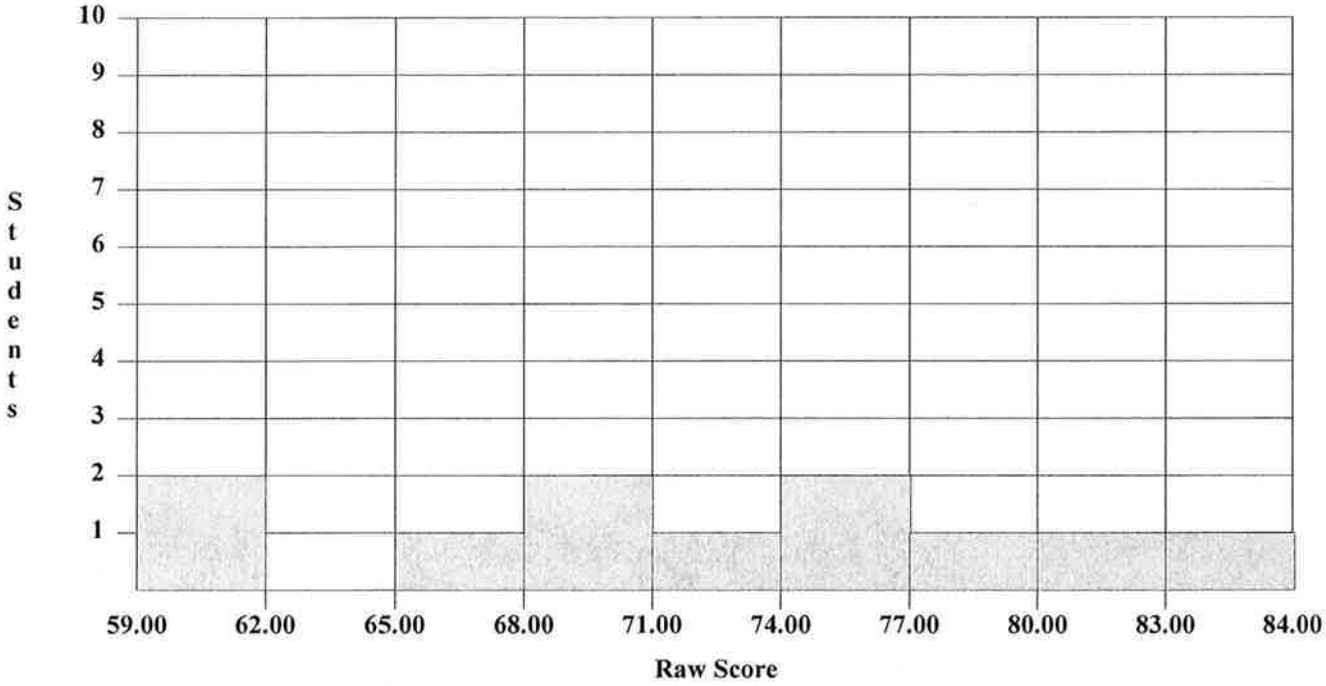

Test Name:	**WCE0821S**	
Test Date:	**10/12/2007**	
Number of Examinees:	**11**	
Number of Items:	**100**	
Maximum Possible Points:	**100.00**	
Highest Score:	**84.00**	**(84.00)**
Lowest Score:	**59.00**	**(59.00)**
Median:	**71.00**	**(71.00)**
Mean:	**71.36**	**(71.36)**
Standard Deviation:	**8.31**	
Test Reliability:	**0.77**	
Standard Error of Measurement:	**3.97**	

MASTERY SUMMARY REPORT

for California-Nevada Water Treatment Grade II Exam

Test Name: WCN0821S — Test version: 0

Scoring Date: Friday, March 25, 2011 — # of Students: 11

# M	**Number Mastering**	**% M**	**% Mastering**	**PTS**	**Possible Points**
# PM	**Number Partial Mastering**	**% PM**	**% Partial Mastering**	**HIGH**	**Highest Points**
# NM	**Number Not Mastering**	**% NM**	**% Not Mastering**	**LOW**	**Lowest Points**
				AVG	**Average Points**

Objective	# M	# PM	# NM	% M	% PM	% NM	PTS	HIGH	LOW	AVG
Perform Administrative Duties	4	7	0	36.36	63.64	0.00	2.00	2.00	1.00	1.36
Perform Administrative Duties-Math	8	0	3	72.73	0.00	27.27	1.00	1.00	0.00	0.73
Collect Samples & Interpret Analysis	7	4	0	63.64	36.36	0.00	5.00	5.00	3.00	3.73
Drinking Water Regulations	5	6	0	45.45	54.55	0.00	15.00	12.00	8.00	10.18
Evaluate Operation of Equipment	7	3	1	63.64	27.27	9.09	3.00	3.00	1.00	2.55
Characteristics of Source Water-Math	10	0	1	90.91	0.00	9.09	1.00	1.00	0.00	0.91
Characteristics of Source Water	10	0	1	90.91	0.00	9.09	4.00	4.00	1.00	3.36
Process Control Laboratory Analysis	4	5	2	36.36	45.45	18.18	13.00	11.00	4.00	8.36
Laboratory Analysis-Math	10	0	1	90.91	0.00	9.09	1.00	1.00	0.00	0.91
Maintain Equipment	11	0	0	100.00	0.00	0.00	8.00	8.00	6.00	7.27
Chemical Treatment/Addition-Math	6	2	3	54.55	18.18	27.27	4.00	4.00	0.00	2.36
Chemical Treatment/Addition	5	3	3	45.45	27.27	27.27	7.00	7.00	2.00	4.09
Clarification/Sedimentation	5	6	0	45.45	54.55	0.00	2.00	2.00	1.00	1.45
Clarification/Sedimentation-Math	5	3	3	45.45	27.27	27.27	3.00	3.00	0.00	2.00
Coagulation and Flocculation	3	7	1	27.27	63.64	9.09	3.00	3.00	1.00	2.18
Coagulation and Flocculation-Math	8	0	3	72.73	0.00	27.27	1.00	1.00	0.00	0.73
Filtration	7	4	0	63.64	36.36	0.00	4.00	4.00	2.00	3.09
Filtration-Math	3	6	2	27.27	54.55	18.18	2.00	2.00	0.00	1.09
Other Treatment Processes	3	5	3	27.27	45.45	27.27	7.00	6.00	1.00	3.64
Residuals Disposal-Math	8	0	3	72.73	0.00	27.27	1.00	1.00	0.00	0.73
Residuals Disposal	8	2	1	72.73	18.18	9.09	4.00	4.00	1.00	3.00
Operate Equipment-Math	10	0	1	90.91	0.00	9.09	1.00	1.00	0.00	0.91
Operate Equipment	11	0	0	100.00	0.00	0.00	4.00	4.00	3.00	3.55
Perform Security & Safety Procedures	6	4	1	54.55	36.36	9.09	3.00	3.00	1.00	2.45
Perform Security Procedures	8	0	3	72.73	0.00	27.27	1.00	1.00	0.00	0.73

TEST STATISTICS REPORT

California-Nevada Water Treatment Grade III Exam

WCN0831S

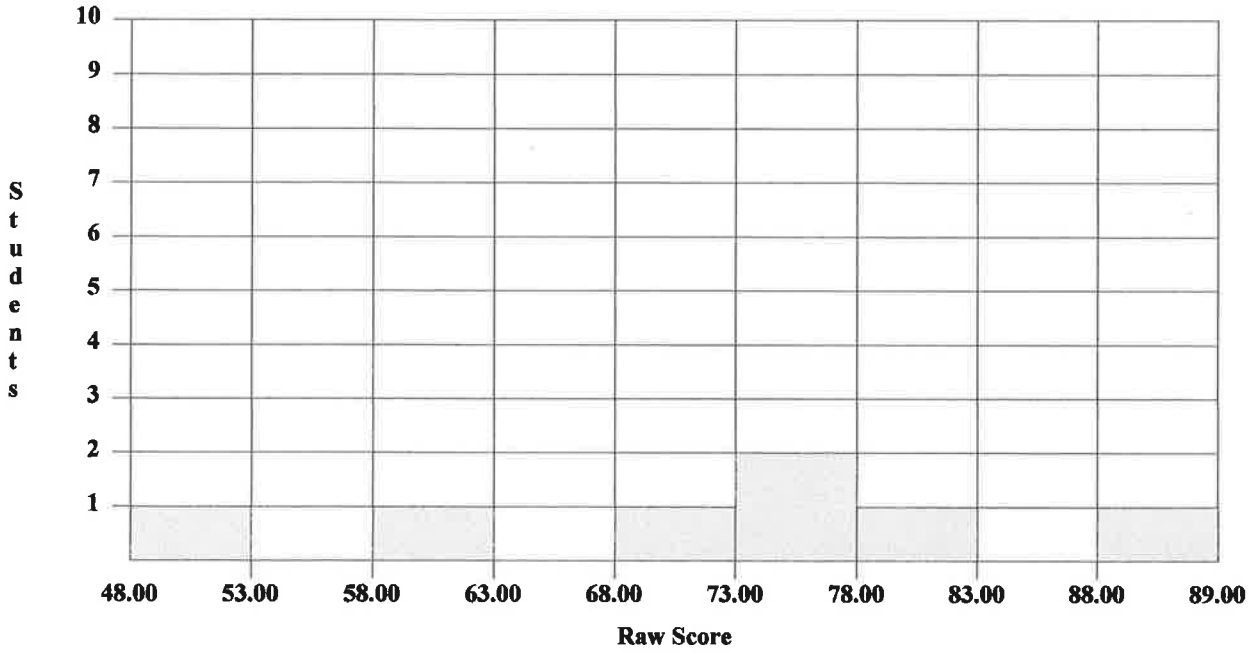

Test Name:	**WCE0831S**	
Test Date:	**10/12/2007**	
Number of Examinees:	**7**	
Number of Items:	**100**	
Maximum Possible Points:	**100.00**	
Highest Score:	**89.00**	**(89.00)**
Lowest Score:	**48.00**	**(48.00)**
Median:	**75.00**	**(75.00)**
Mean:	**71.71**	**(71.71)**
Standard Deviation:	**13.49**	
Test Reliability:	**0.91**	
Standard Error of Measurement:	**3.95**	

MASTERY SUMMARY REPORT

for California-Nevada Water Treatment Grade III

Test Name: WCN0831S — Test version: 0

Scoring Date: 4/5/2011 — # of Students: 7

# M	**Number Mastering**	**% M**	**% Mastering**	**PTS**	**Possible Points**
# PM	**Number Partial Mastering**	**% PM**	**% Partial Mastering**	**HIGH**	**Highest Points**
# NM	**Number Not Mastering**	**% NM**	**% Not Mastering**	**LOW**	**Lowest Points**
				AVG	**Average Points**

Objective	# M	# PM	# NM	% M	% PM	% NM	PTS	HIGH	LOW	AVG
Perform Administrative Duties	7	0	0	100.00	0.00	0.00	1.00	1.00	1.00	1.00
Perform Administrative Duties-Math	4	0	3	57.14	0.00	42.86	1.00	1.00	0.00	0.57
Collect Samples & Interpret Analysis	6	1	0	85.71	14.29	0.00	10.00	9.00	5.00	7.71
Drinking Water Regulations	4	3	0	57.14	42.86	0.00	15.00	13.00	7.00	10.43
Evaluate Operation of Equipment	7	0	0	100.00	0.00	0.00	4.00	4.00	3.00	3.57
Characteristics of Source Water	7	0	0	100.00	0.00	0.00	5.00	5.00	4.00	4.86
Process Control Laboratory Analysis	3	2	2	42.86	28.57	28.57	6.00	6.00	2.00	4.00
Maintain Equipment	4	1	2	57.14	14.29	28.57	6.00	6.00	1.00	4.00
Chemical Treatment/Addition-Math	3	1	3	42.86	14.29	42.86	3.00	3.00	0.00	1.86
Chemical Treatment/Addition	1	6	0	14.29	85.71	0.00	9.00	8.00	4.00	5.14
Clarification/Sedimentation	4	2	1	57.14	28.57	14.29	2.00	2.00	0.00	1.43
Clarification/Sedimentation-Math	6	0	1	85.71	0.00	14.29	2.00	2.00	0.00	1.71
Coagulation and Flocculation	1	4	2	14.29	57.14	28.57	3.00	3.00	0.00	1.57
Coagulation and Flocculation-Math	6	0	1	85.71	0.00	14.29	1.00	1.00	0.00	0.86
Filtration	4	3	0	57.14	42.86	0.00	7.00	7.00	3.00	4.86
Filtration-Math	1	5	1	14.29	71.43	14.29	2.00	2.00	0.00	1.00
Other Treatment Processes	5	2	0	71.43	28.57	0.00	8.00	7.00	4.00	5.71
Residuals Disposal-Math	6	0	1	85.71	0.00	14.29	1.00	1.00	0.00	0.86
Residuals Disposal	4	3	0	57.14	42.86	0.00	3.00	3.00	2.00	2.57
General Math	3	3	1	42.86	42.86	14.29	2.00	2.00	0.00	1.29
Operate Equipment	4	3	0	57.14	42.86	0.00	5.00	5.00	3.00	3.86
Perform Security & Safety Procedures	6	1	0	85.71	14.29	0.00	2.00	2.00	1.00	1.86
Perform Security Procedures	1	5	1	14.29	71.43	14.29	2.00	2.00	0.00	1.00

TEST STATISTICS REPORT

California-Nevada Water Treatment Grade IV Exam

WCN0841S

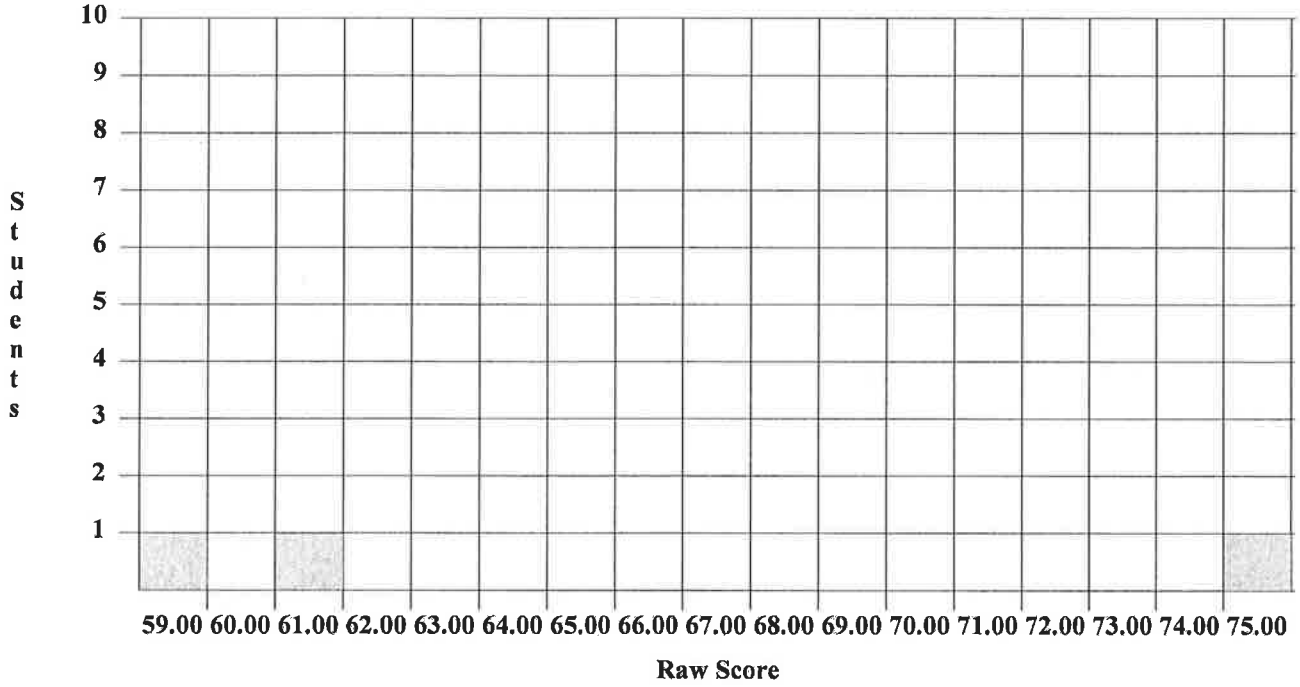

Test Name:	**WCE0841S**	
Test Date:	**10/12/2007**	
Number of Examinees:	**3**	
Number of Items:	**100**	
Maximum Possible Points:	**100.00**	
Highest Score:	**75.00**	**(75.00)**
Lowest Score:	**59.00**	**(59.00)**
Median:	**61.00**	**(61.00)**
Mean:	**65.00**	**(65.00)**
Standard Deviation:	**8.72**	
Test Reliability:	**0.76**	
Standard Error of Measurement:	**4.25**	

MASTERY SUMMARY REPORT

for California-Nevada Water Treatment Grade IV Exam

Test Name: WCN0841S — Test version: 0

Scoring Date: Friday, March 25, 2011 — # of Students: 3

# M	**Number Mastering**	**% M**	**% Mastering**	**PTS**	**Possible Points**
# PM	**Number Partial Mastering**	**% PM**	**% Partial Mastering**	**HIGH**	**Highest Points**
# NM	**Number Not Mastering**	**% NM**	**% Not Mastering**	**LOW**	**Lowest Points**
				AVG	**Average Points**

Objective	# M	# PM	# NM	% M	% PM	% NM	PTS	HIGH	LOW	AVG
Perform Administrative Duties	2	0	1	66.67	0.00	33.33	1.00	1.00	0.00	0.67
Perform Administrative Duties-Math	2	1	0	66.67	33.33	0.00	2.00	2.00	1.00	1.67
Collect Samples & Interpret Analysis	3	0	0	100.00	0.00	0.00	11.00	10.00	8.00	9.00
Drinking Water Regulations	2	1	0	66.67	33.33	0.00	15.00	12.00	8.00	10.33
Evaluate Operation of Equipment	1	0	2	33.33	0.00	66.67	4.00	3.00	0.00	1.33
Characteristics of Source Water	2	1	0	66.67	33.33	0.00	5.00	5.00	2.00	3.67
Process Control Laboratory Analysis	3	0	0	100.00	0.00	0.00	5.00	5.00	4.00	4.67
Maintain Equipment	3	0	0	100.00	0.00	0.00	7.00	6.00	5.00	5.67
Chemical Treatment/Addition-Math	0	2	1	0.00	66.67	33.33	3.00	2.00	1.00	1.67
Chemical Treatment/Addition	3	0	0	100.00	0.00	0.00	7.00	6.00	5.00	5.67
Clarification/Sedimentation	2	1	0	66.67	33.33	0.00	6.00	5.00	3.00	4.33
Clarification/Sedimentation-Math	3	0	0	100.00	0.00	0.00	1.00	1.00	1.00	1.00
Coagulation and Flocculation	1	2	0	33.33	66.67	0.00	5.00	4.00	2.00	2.67
Coagulation and Flocculation-Math	0	0	3	0.00	0.00	100.00	4.00	1.00	0.00	0.33
Filtration	0	1	2	0.00	33.33	66.67	6.00	3.00	1.00	2.00
Filtration-Math	3	0	0	100.00	0.00	0.00	1.00	1.00	1.00	1.00
Other Treatment Processes	1	1	1	33.33	33.33	33.33	4.00	4.00	0.00	2.00
Other Treatment Processes-Math	2	0	1	66.67	0.00	33.33	1.00	1.00	0.00	0.67
Residuals Disposal-Math	2	0	1	66.67	0.00	33.33	1.00	1.00	0.00	0.67
Residuals Disposal	1	0	2	33.33	0.00	66.67	3.00	3.00	0.00	1.33
General Math	1	0	2	33.33	0.00	66.67	1.00	1.00	0.00	0.33
Operate Equipment-Math	2	0	1	66.67	0.00	33.33	1.00	1.00	0.00	0.67
Operate Equipment	1	1	1	33.33	33.33	33.33	3.00	3.00	1.00	2.00
Perform Security & Safety Procedures	0	2	1	0.00	66.67	33.33	3.00	2.00	1.00	1.67