


# LEGEND

## EXISTING WATER LINES

- 4"  $\phi$
- 6"  $\phi$
- 8"  $\phi$
- 10"  $\phi$
- 12"  $\phi$
- UNKNOWN  $\phi$

## PROPOSED WATER LINE

- 12"  $\phi$

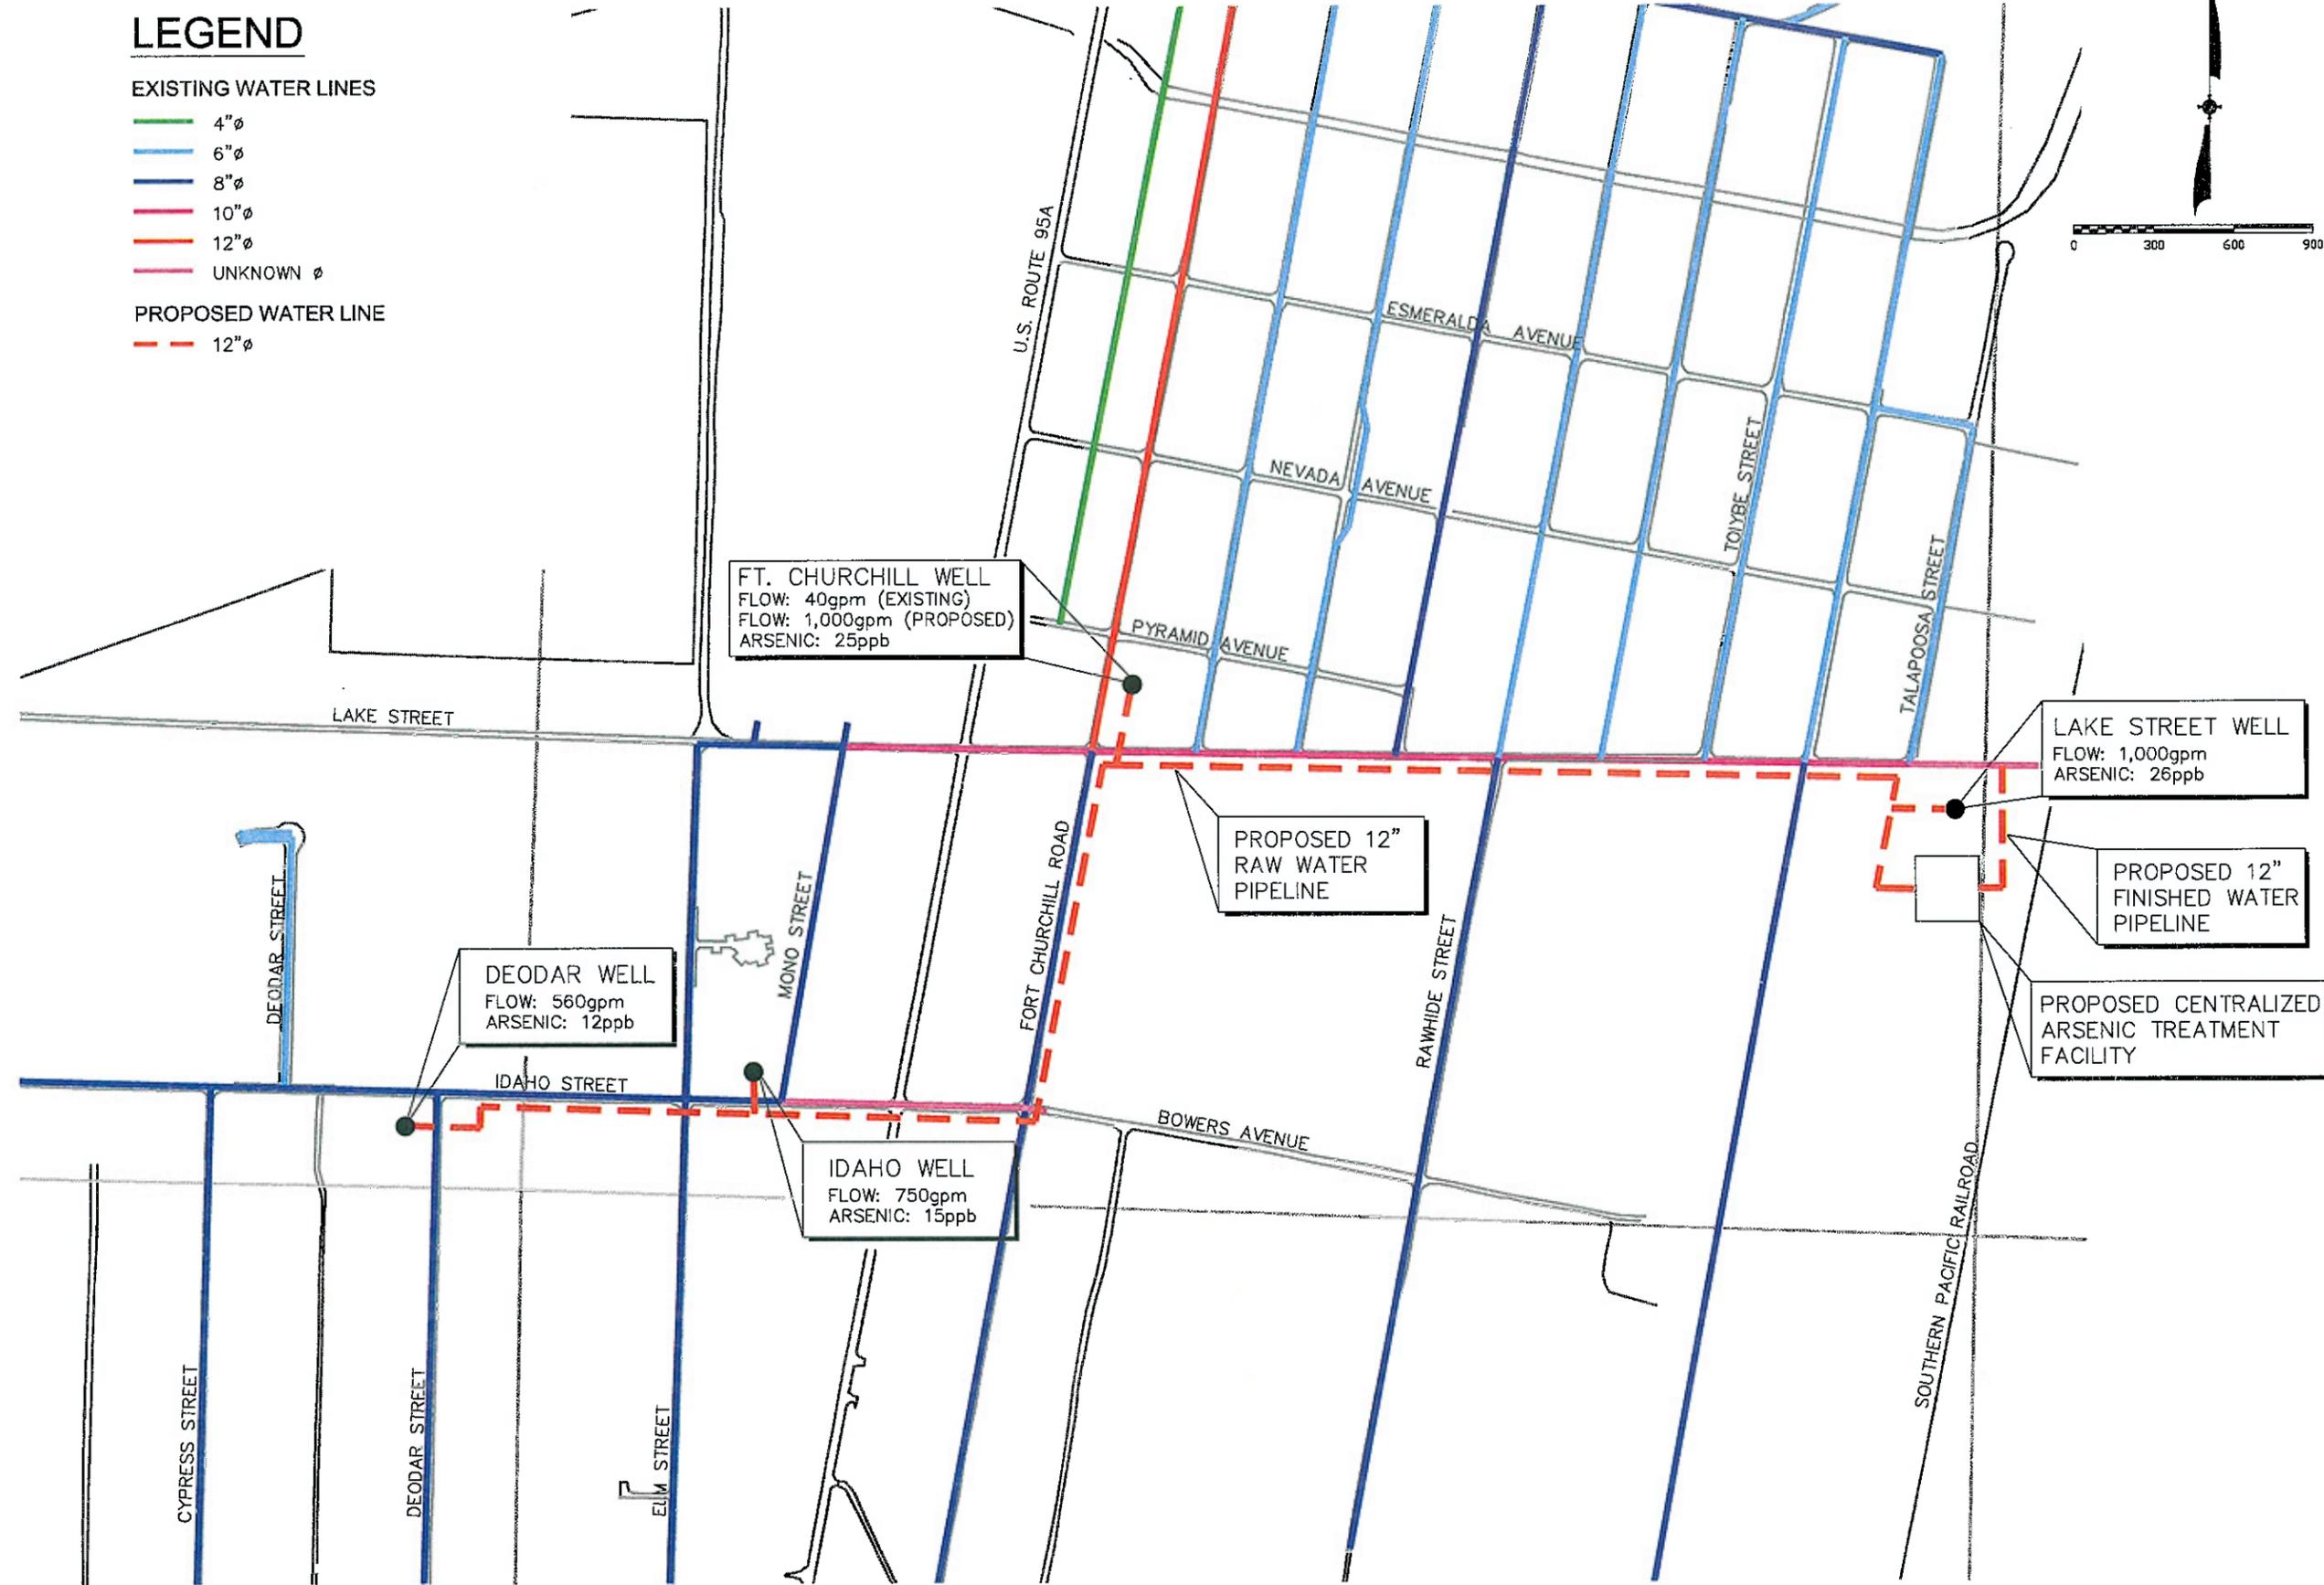

**FT. CHURCHILL WELL**  
 FLOW: 40gpm (EXISTING)  
 FLOW: 1,000gpm (PROPOSED)  
 ARSENIC: 25ppb

**LAKE STREET WELL**  
 FLOW: 1,000gpm  
 ARSENIC: 26ppb

**DEODAR WELL**  
 FLOW: 560gpm  
 ARSENIC: 12ppb

**IDAHO WELL**  
 FLOW: 750gpm  
 ARSENIC: 15ppb

PROPOSED 12" RAW WATER PIPELINE

PROPOSED 12" FINISHED WATER PIPELINE

PROPOSED CENTRALIZED ARSENIC TREATMENT FACILITY

REVISIONS	DATE	APPROVED

JOB NO. SSMWC 06-02	DESIGNED: BRE	DRAWN: VAW	CHECKED: VAW	DATE: 12/27/06
---------------------	---------------	------------	--------------	----------------

**FIGURE 2**  
**SSMWC ARSENIC**  
**MANAGEMENT REPORT**  
**WATER SYSTEM SCHEMATIC**  
 SILVER SPRINGS NEVADA

5442 LONGLEY LANE, SUITE B  
 RENO, NEVADA 89511  
 PHONE: (775) 851-4788  
 FAX: (775) 851-0766